
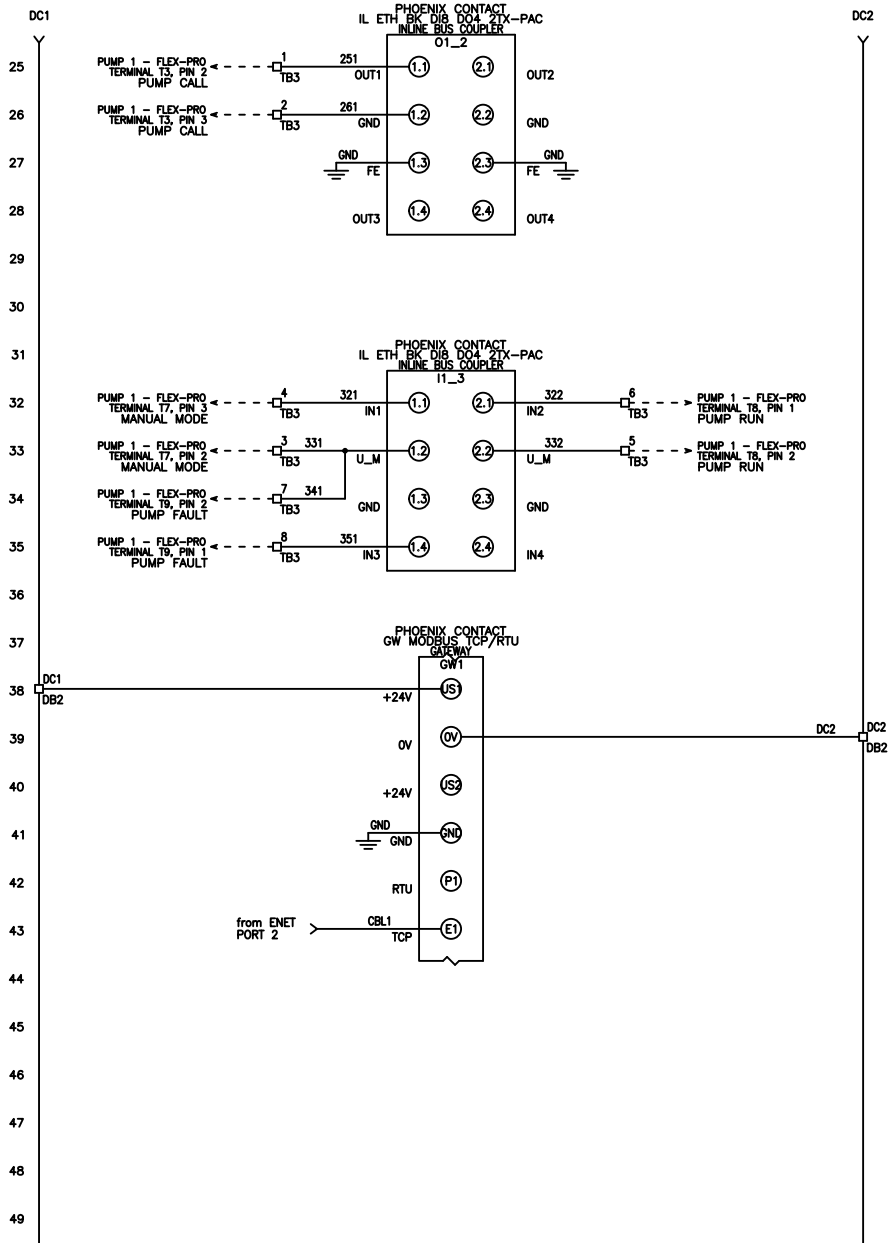


FNAME: CP1377-A

REVDATE: 0619

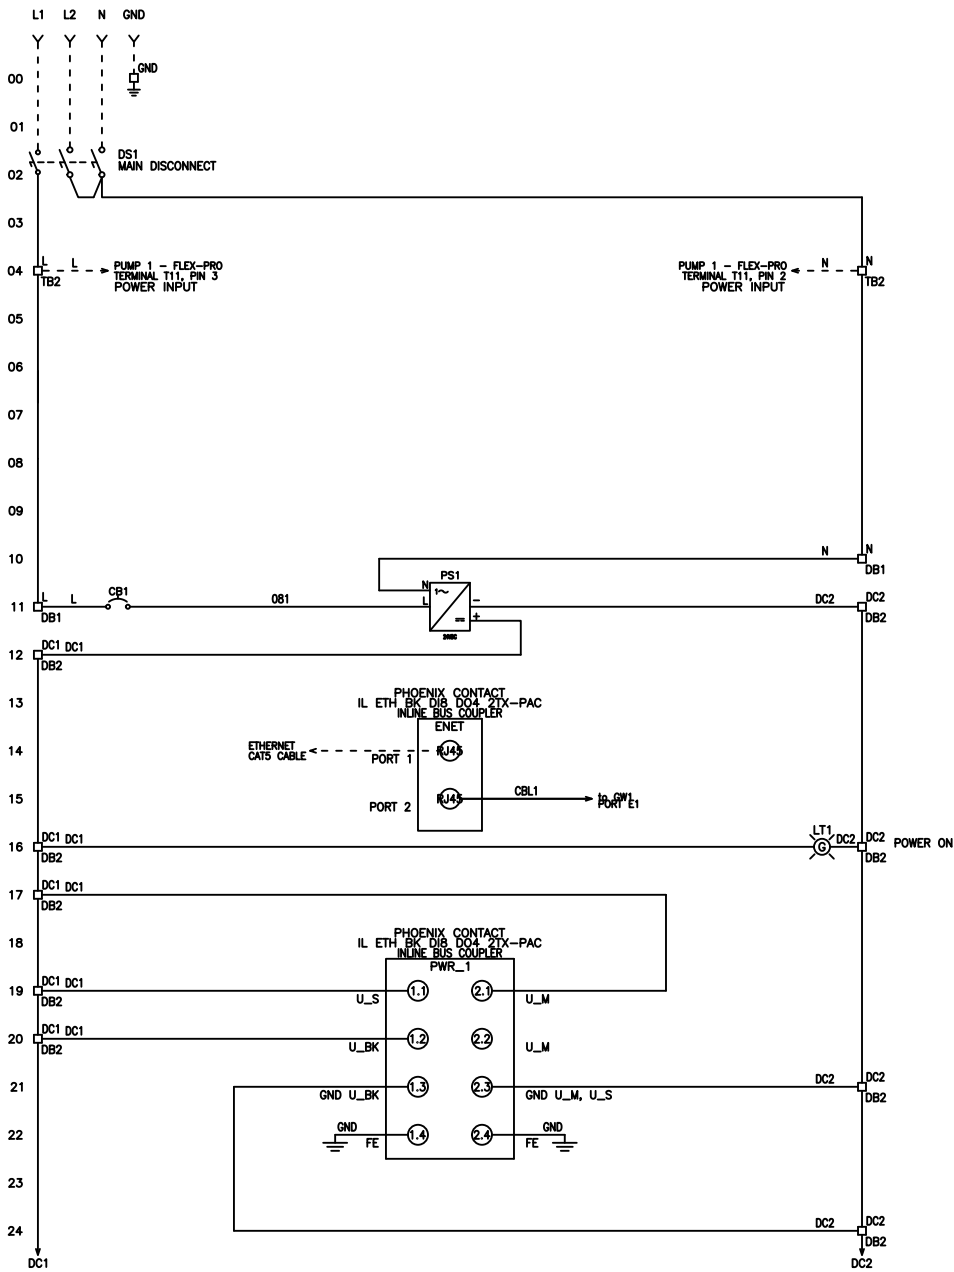

----- DASHED LINE INDICATES FIELD WIRING.


USE COPPER CONDUCTORS ONLY.
TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).
BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.
VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	
	E	ADDED GW1	6/27/19	

DRAWN BY:		DATE:		<div><div>Blue-White</div><div>Industries, Ltd.</div></div>							
AO 11/29/18		DATE:									
APPROVED BY:		DATE:		TITLE: CP1377-A SIMPLEX CONTROL SCHEMATIC							
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.				SIZE		DWG NO.		PART NO.		REV	
				B		759		CP1377-A		E	
				SCALE		NONE				SHEET	

FNAME: CP1377-A

REVDATE: 0619



DASHED LINE INDICATES
FIELD WIRING.

USE COPPER CONDUCTORS ONLY.


TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).


BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	REMOVED TB1	2/05/19	
	B	UPDATED WIRING	2/19/19	
	C	UPDATED FIELD WIRING CONNECTION LABELS AND SUPPLY VOLTAGE	3/12/19	
	D	REVISED FELX-PRO T7 WIRING & LABEL	4/17/19	
	E	ADDED GW1	6/27/19	

FIELD WIRING CONNECTIONS

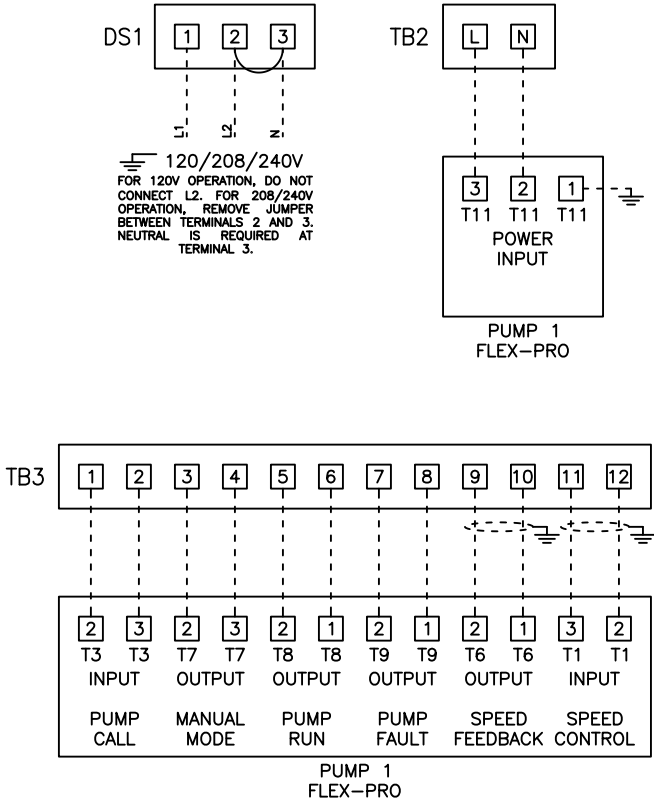

DRAWN BY:		DATE:									
AO 11/29/18											
APPROVED BY:		DATE:		TITLE: CP1377-A SIMPLEX CONTROL SCHEMATIC							
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.				SIZE		DWG NO.		PART NO.		REV	
				B		759		CP1377-A		E	
				SCALE		NONE				SHEET	